



**CENTRAL MATERIAL TESTING LABORATORY
WAPDA, LAHORE.**


TESTING OF CEMENT

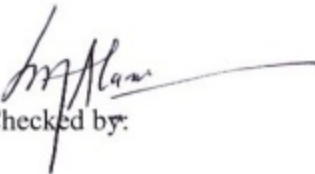
AGENCY: Manager Procurement Gharib Wal Cement Limited 34-Main Gulberg Lahore.
PROJECT: Not mentioned
REF. No.: GCL/cmmt tst cmtl Dated: 28-10-2008
LAB. No.: 5227
CEMENT: Paidar Cement (OPC) Gharib Wal Cement Ltd.


HEAT OF HYDRATION OF CEMENT
(ASTM C-186)

Sr. No.	Sample Description	Heat of Hydration	
		7 Days	28 Days
1	Paidar Cement (OPC)	311 KJ/Kg	334 KJ/Kg

Note: This report is solely based on the testing of Samples provided to the Lab.

Compiled by: 
(Muhammad Aslam ARO)
11/12/08

Checked by: 


ZIAULLAH MUGHAL
Senior Engineer
CMTL WAPDA, LAHORE.